


THERMAL IMAGE

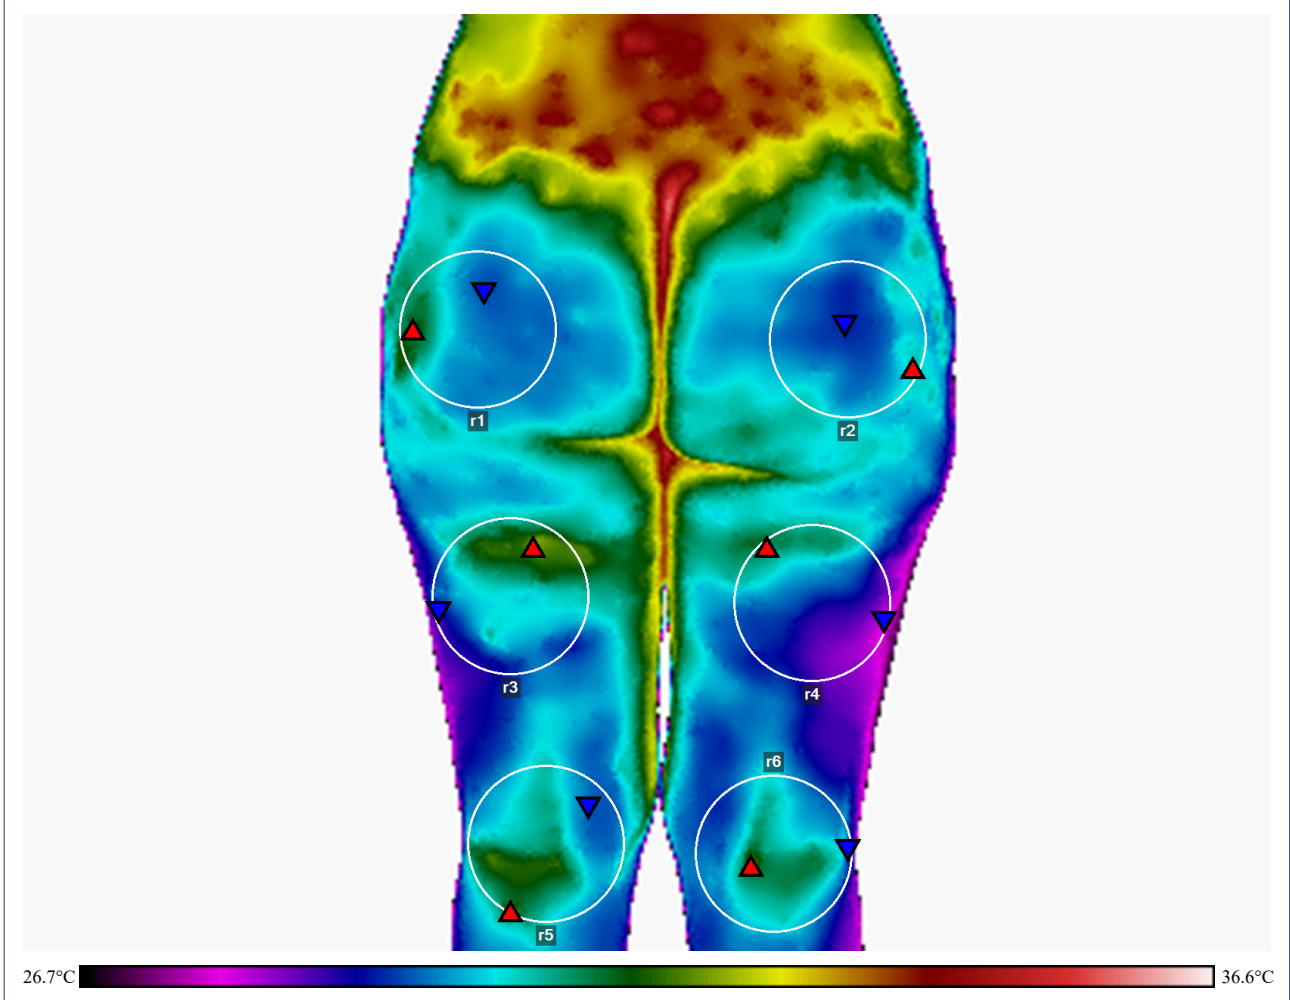

ROI	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1	<b>31.54</b>	29.45	29.98	2.09	0.48	0.23	3.98	1.98
r2	30.60	29.24	29.78	1.36	0.33	0.11	3.78	1.78
r3	32.20	28.66	30.43	3.54	0.81	0.66	4.43	2.43
r4	31.29	<b>27.74</b>	29.42	3.55	0.83	0.68	3.42	1.42
r5	31.96	29.49	30.54	2.47	0.62	0.38	4.54	2.54
r6	31.83	28.85	30.30	2.98	0.53	0.28	4.30	2.30


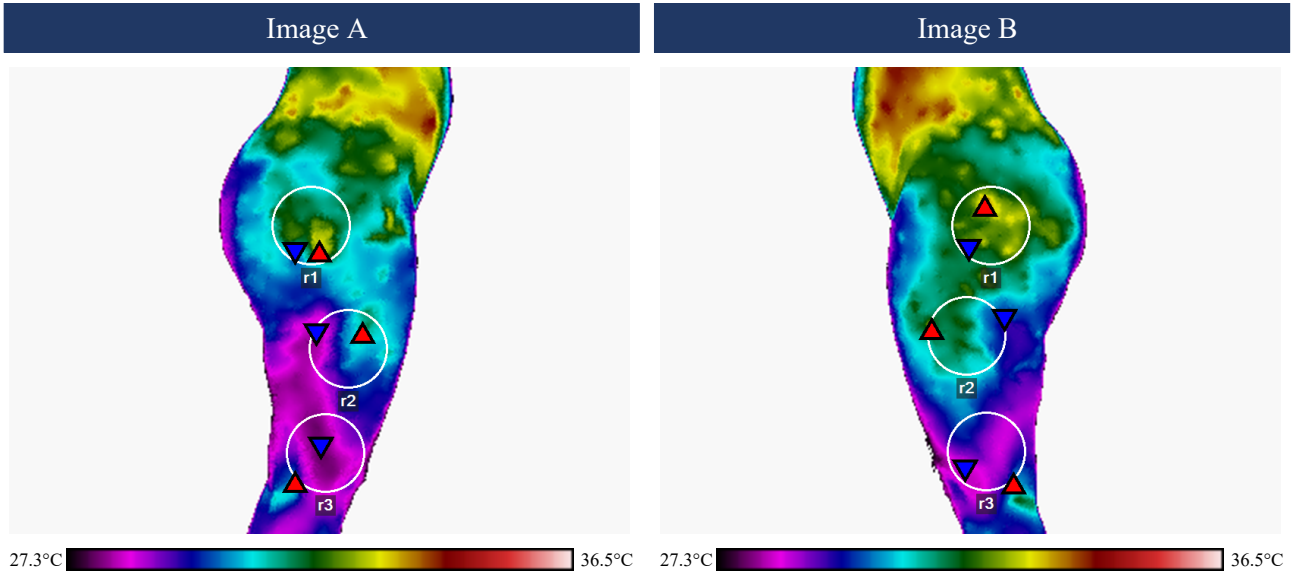


Image A						
	Max	Min	Mean	Ampl	s.d.	DCT
r1	<b>32.95</b>	30.02	31.50	2.93	0.57	4.17
r2	31.50	<b>27.92</b>	29.75	3.58	0.85	30.05
r3	30.05	<b>27.78</b>	28.34	2.27	0.41	4.17

Image B						
	Max	Min	Mean	Ampl	s.d.	DCT
r1	<b>33.76</b>	31.36	32.18	2.40	0.42	13.18
r2	32.13	29.33	30.89	2.80	0.62	22.44
r3	30.24	28.16	28.91	2.08	0.45	8.33

Image A-B						
	Max	Min	Mean	Ampl	s.d.	DCT
r1 A-B	<b>-0.81</b>	<b>-1.34</b>	<b>-0.69</b>	<b>0.53</b>	0.15	-9.01
r2 A-B	<b>-0.63</b>	<b>-1.41</b>	<b>-1.14</b>	<b>0.78</b>	0.22	7.61
r3 A-B	-0.19	<b>-0.38</b>	<b>-0.57</b>	0.19	-0.04	-4.17

### THERMAL IMAGE

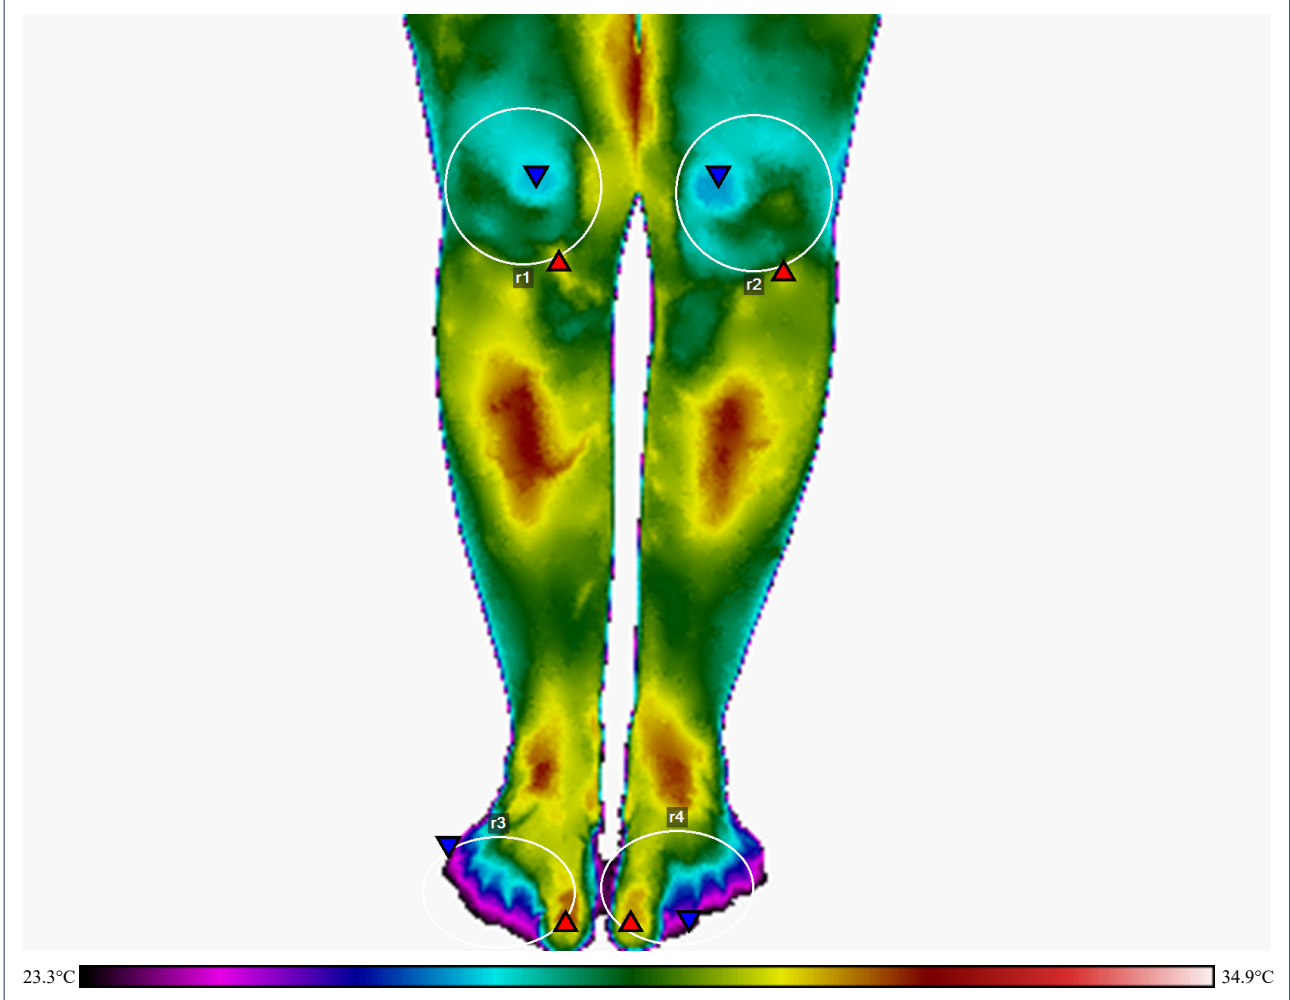

ROI	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1	30.53	27.20	28.42	3.33	0.69	0.48	2.42	0.42
r2	29.66	27.01	28.12	2.65	0.54	0.29	2.12	0.12
r3	31.81	23.30	27.40	8.51	2.34	5.48	1.40	-0.60
r4	31.04	23.30	27.75	7.74	2.23	4.98	1.75	-0.25

Delta	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1-r2	<b>0.87</b>	0.19	0.30	0.68	0.15	0.18	0.30	0.30
r3-r4	<b>0.77</b>	0.00	-0.36	0.77	0.11	0.50	-0.36	-0.36