

Image A

Image B



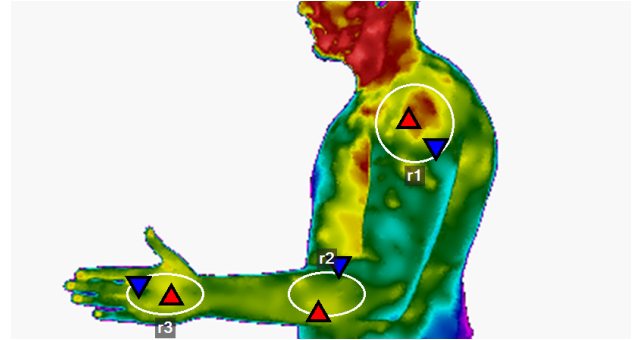


Image A						
	Max°C	Min°C	Mean°C	Ampl°C	s.d.°C	DCT
r1	32.04	29.69	30.91	2.35	0.43	15.02
r2	32.06	30.19	31.18	1.87	0.40	11.31
r3	31.89	30.04	31.43	1.85	0.30	7.53

Image B						
	Max°C	Min°C	Mean°C	Ampl°C	s.d.°C	DCT
r1	32.90	30.11	31.49	2.79	0.63	20.83
r2	31.47	30.16	31.01	1.31	0.25	7.38
r3	31.66	30.21	31.17	1.45	0.25	4.53


Image A-B						
	Max°C	Min°C	Mean°C	Ampl°C	s.d.°C	DCT
r1 A-B	-0.86	-0.42	-0.58	-0.44	-0.20	-5.81
r2 A-B	0.59	0.03	0.16	0.56	0.14	3.93
r3 A-B	0.23	-0.17	0.26	0.40	0.05	3.00

THERMAL IMAGE

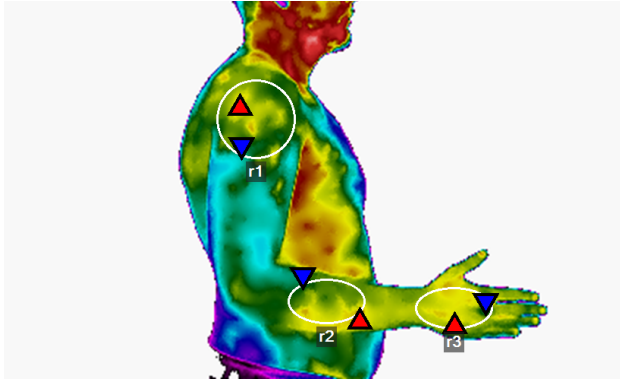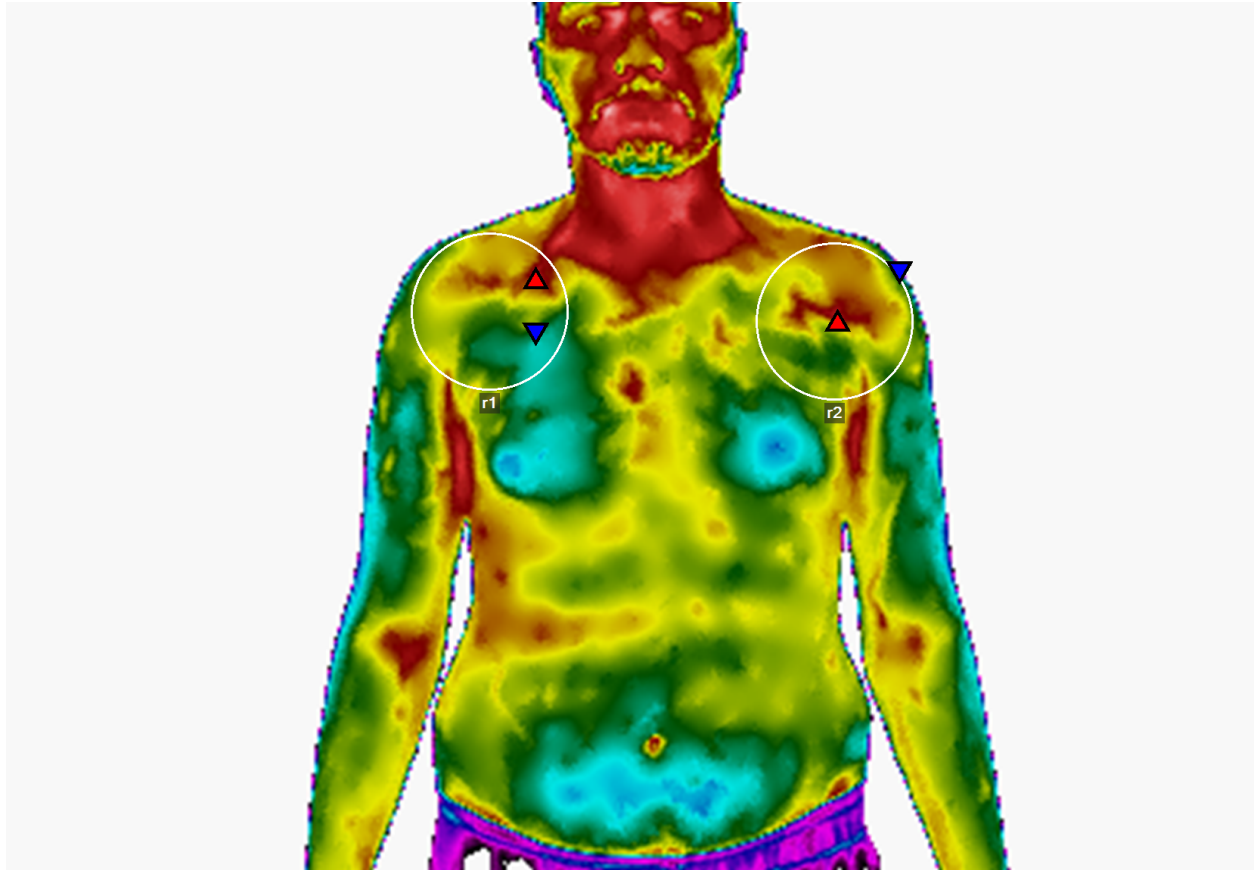

26.1°C  35.2°C

ROI	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1	33.49	29.57	31.29	3.92	0.85	0.72	5.29	3.29
r2	33.37	30.40	31.66	2.97	0.63	0.40	5.66	3.66
Delta	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1-r2	0.12	-0.83	-0.37	0.95	0.22	0.32	-0.37	-0.37

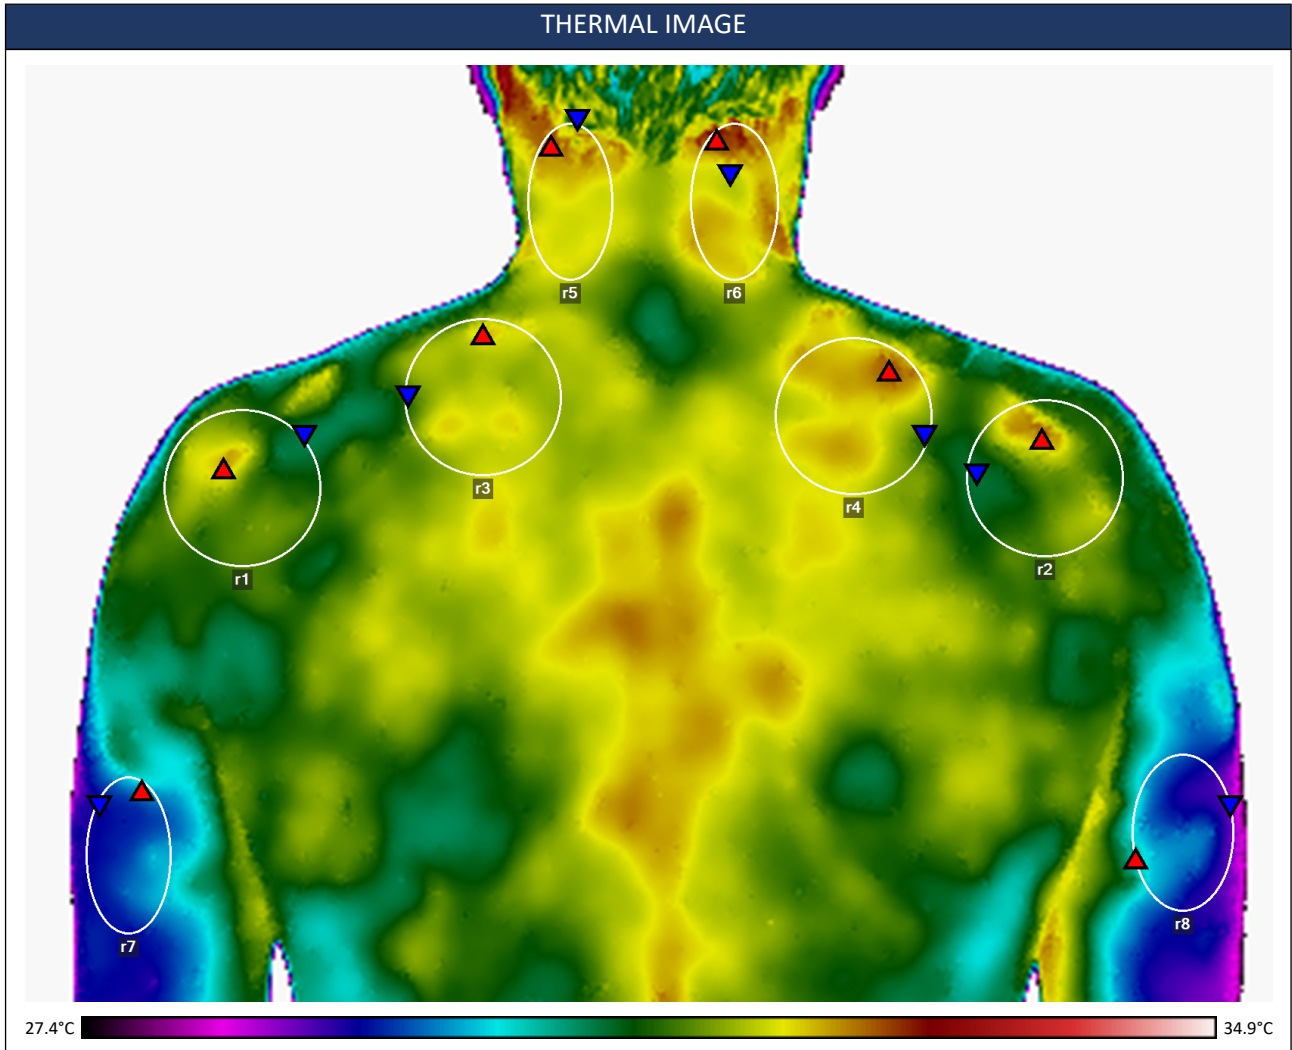

ROI	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1	32.43	30.74	31.42	1.69	0.32	0.10	5.42	3.42
r2	32.70	30.82	31.43	1.88	0.39	0.15	5.43	3.43
r3	32.22	31.21	31.80	1.01	0.15	0.02	5.80	3.80
r4	32.63	31.16	32.05	1.47	0.26	0.07	6.05	4.05
r5	32.77	31.33	32.06	1.44	0.19	0.04	6.06	4.06
r6	32.93	31.74	32.18	1.19	0.23	0.05	6.18	4.18
r7	30.08	29.17	29.51	0.91	0.23	0.05	3.51	1.51
r8	30.39	28.62	29.43	1.77	0.35	0.12	3.43	1.43

Delta	Max °C	Min °C	Mean °C	Ampl °C	s.d. °C	s <sup>2</sup>	T1	T2
r1-r2	-0.27	-0.08	-0.01	-0.19	-0.07	-0.05	-0.01	-0.01
r3-r4	-0.41	0.05	-0.24	-0.46	-0.11	-0.05	-0.24	-0.24
r5-r6	-0.16	-0.41	-0.13	0.25	-0.04	-0.01	-0.13	-0.13